
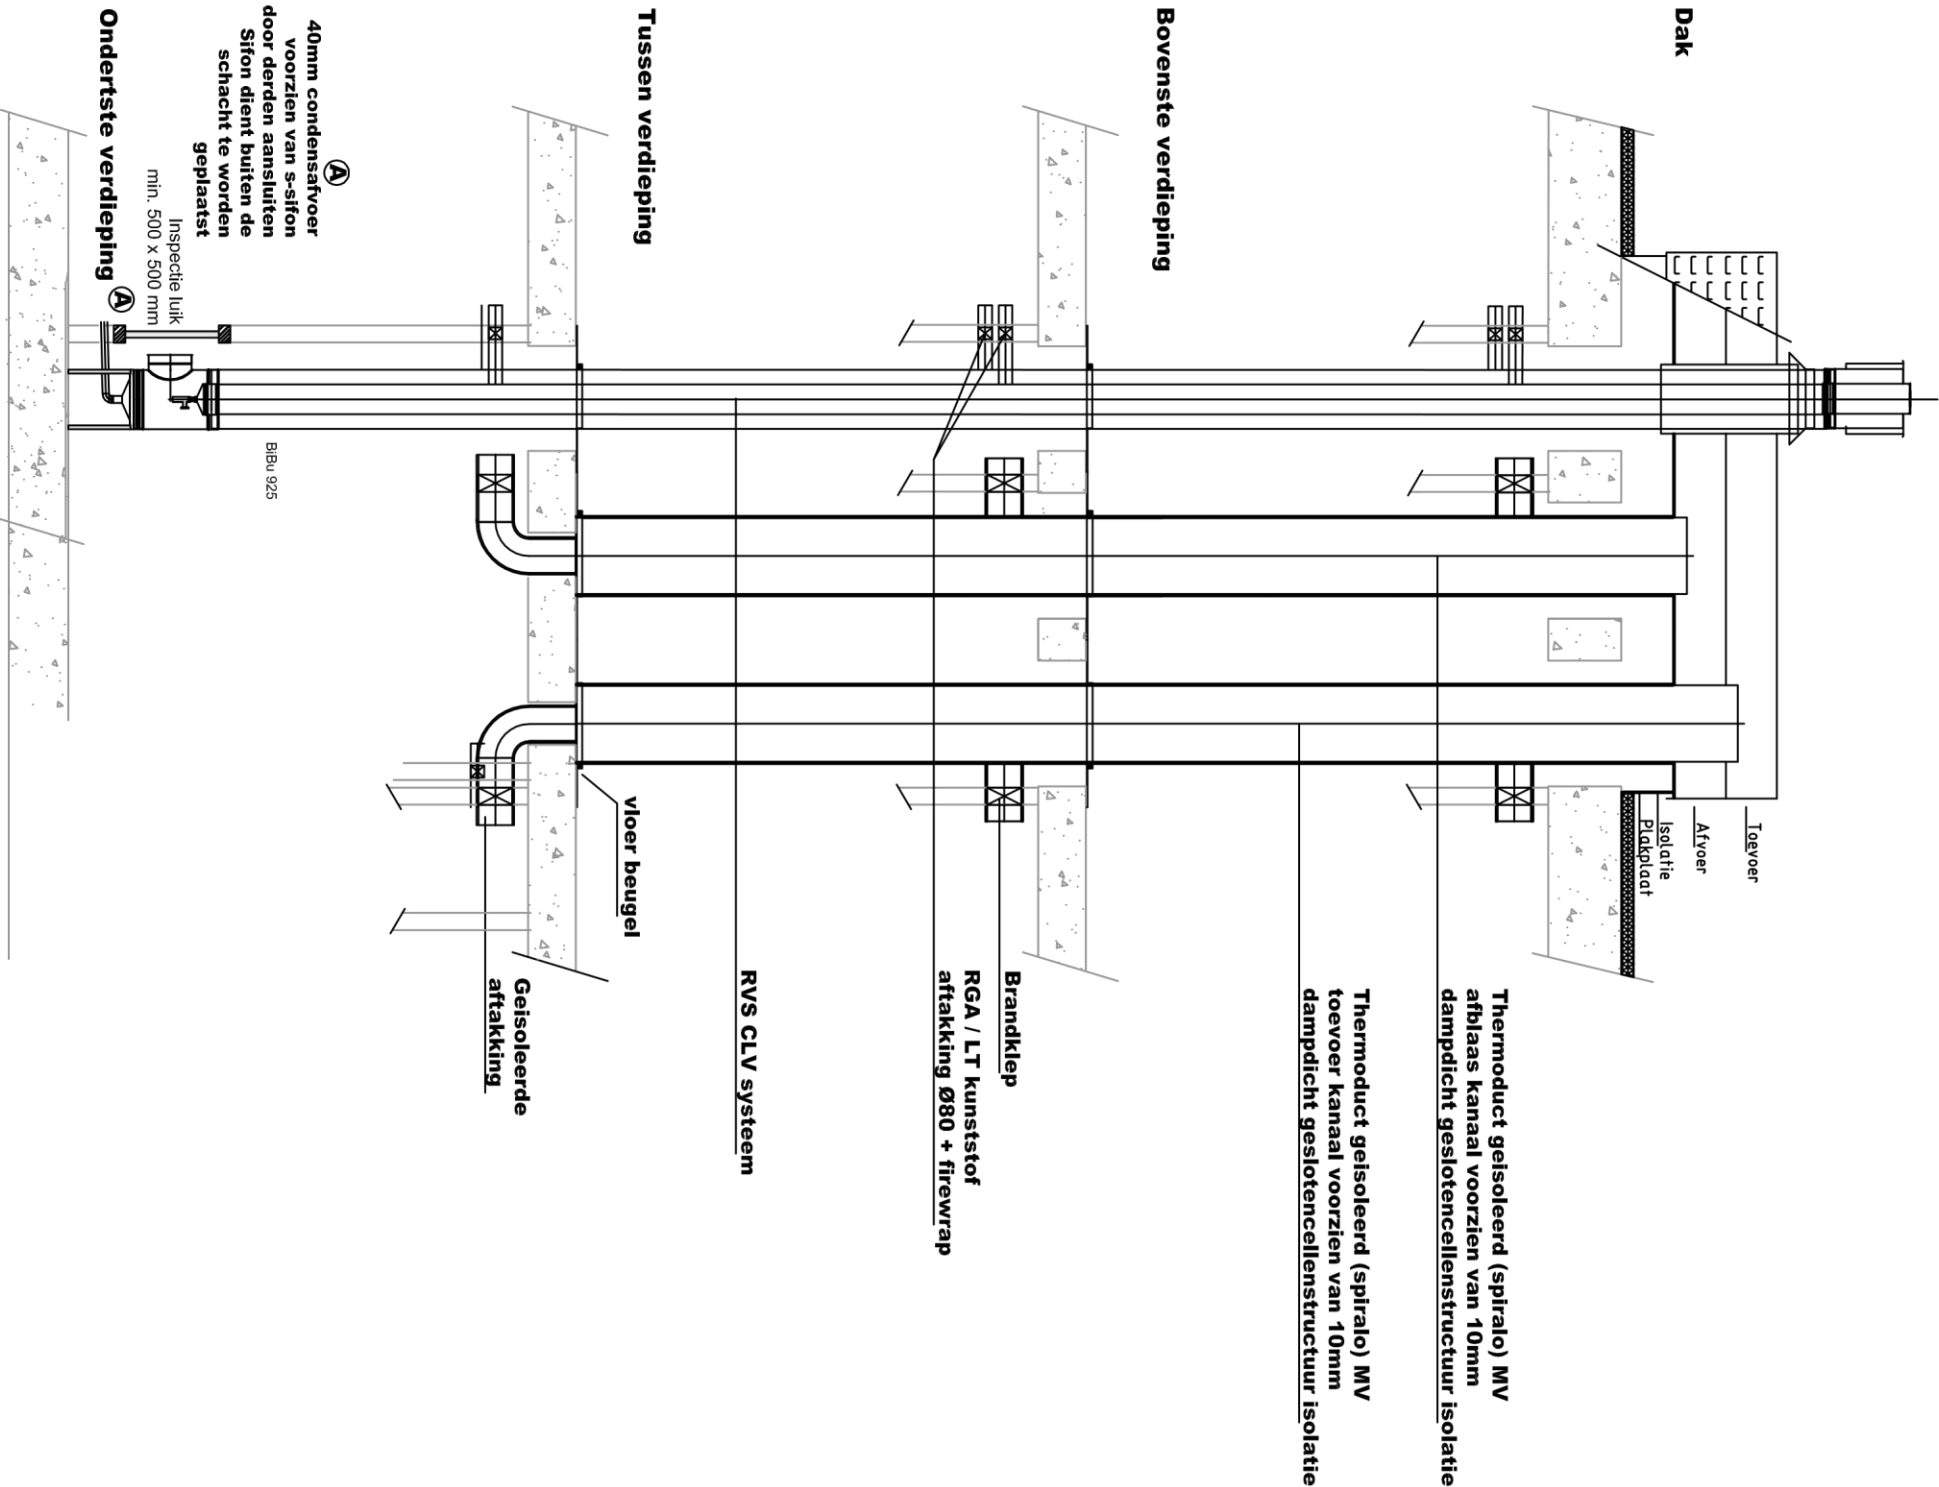


CLV-systeem			
Aantal ketels	Lucht toevoer	Rookgas afvoer	
2	262	139	
3	300	160	
4	355	178	
5	376	200	
6	413	220	
7	445	237	
8	476	254	
9	504	268	
10	532	283	
11	544	290	
12	566	303	
13	591	315	
14	614	327	
15	635	339	
16	639	340	
17	659	352	
18	678	361	
19	697	372	
20	715	381	

LA en LT kanalen t.b.v. MV uitgangspunten: 600 m3/h per woning en luchtsnelheid 5 m/s			
Aantal units	Lucht afvoer	Lucht toevoer	
2	300	300	
3	355	355	
4	450	450	
5	450	450	
6	500	500	
7	560	560	
8	600	600	
9	630	630	
10	630	630	
11	710	710	
12	710	710	
13	800	800	
14	800	800	
15	800	800	
16	800	800	
17	900	900	
18	900	900	
19	900	900	
20	1000	1000	

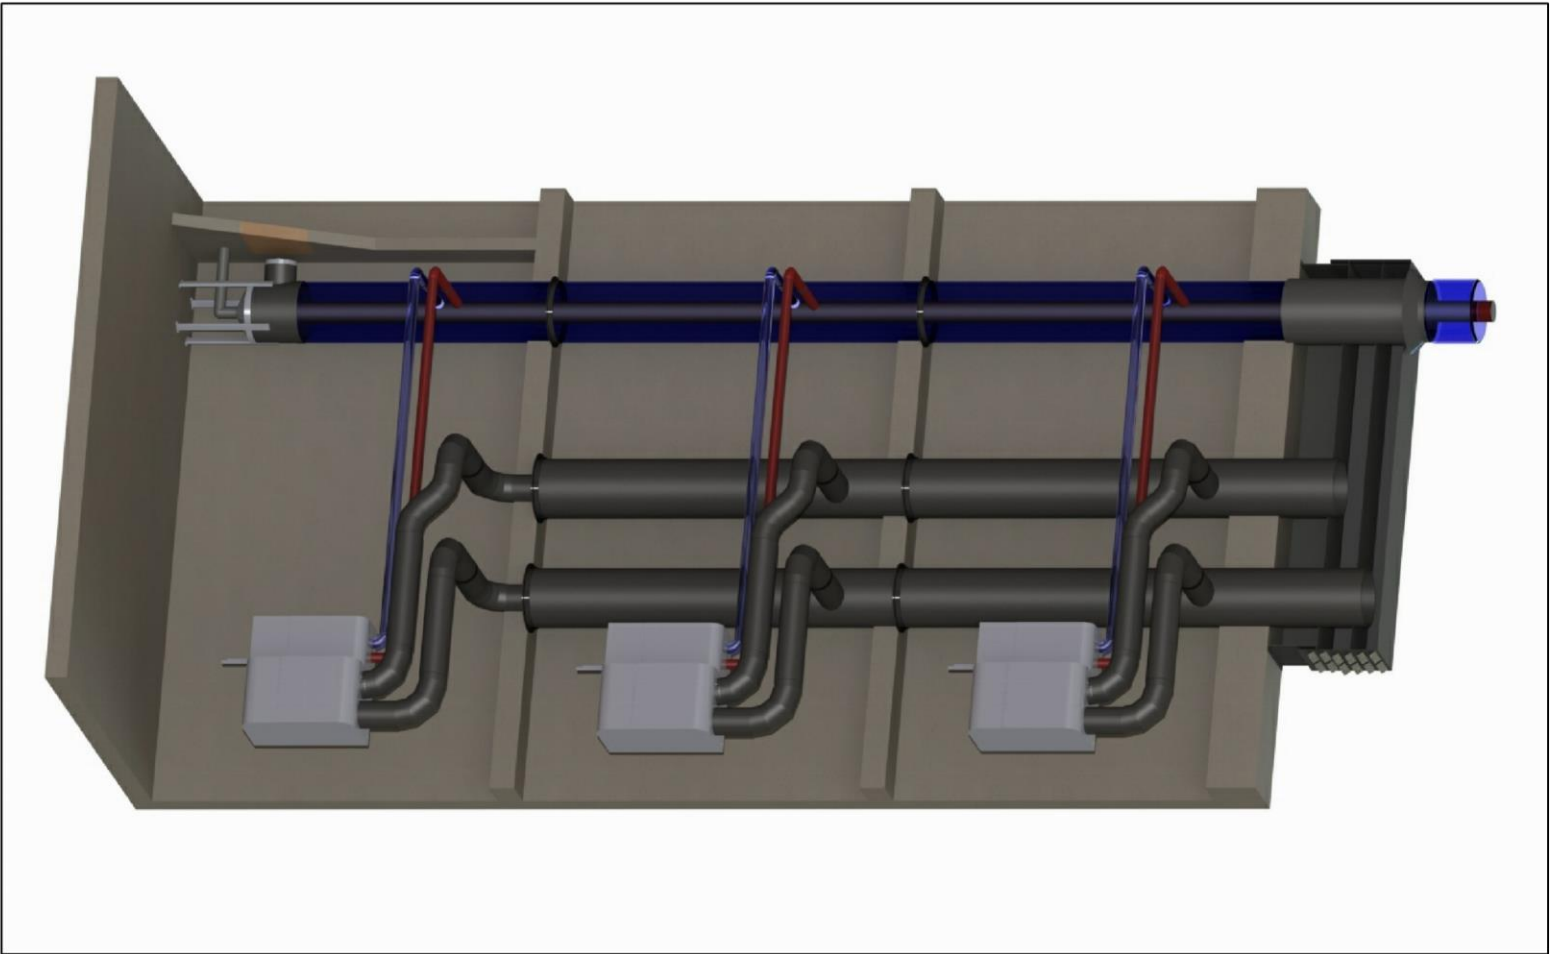

Gewijzigd d.d.:					
Schaal:	div	Werk:		ITHO Daalderop warmtepompen	
Gelekend:					
Datum:					
Gelekend met:	Autocad 2006				
File naam:					
Benaming:	Principe tekening CLV systeem en MV af- en toevoer kanaal				

ECO
NOX

Postbus 15 - 5690 AA Eindhoven
Tel. +31 (0) 499 496377 Fax. +31 (0) 499 477874
email : info@econox.nl web: www.econox.nl

PRINCIPE

Projectnr.:

1

101 CLV-CAV (R)